

宝鸡钛业股份有限公司电机修理合格维修商采购公告

(采购编号: SBB2025024)

- 一、项目名称: 宝鸡钛业股份有限公司关于 电机修理合格维修商 的采购公告
- 二、采购项目内容、规模及概况: 电机修理合格维修商 采购
- 三、资金来源信息: 自筹资金
- 四、监督部门名称: 宝钛集团有限公司纪委综合室
- 五、供应商的资格能力要求: 供应商为中华人民共和国境内注册的法人, 具有独立签订合同的权利和良好履行合同的能力, 为电机维修商, 维修商应具有高压电机维修的相关资质。单位负责人为同一人或存在控股、管理关系的不同单位, 不得同时参加本次采购项目。
- 六、本项目不接受联合体响应。

七、公告内容:

(一) 采购内容: 高压电机维修

(二) 技术要求:

电机参数: 具体详见附件

电机型号	功率	转速	防护等级	额定电流	额定电压	重量	生产厂家
HGF 400C/D/E	450KW	990rpm	IP55	53.9A	6KV	4734kg	WEG(万高)

附件 1: 高压电机参数表

附件 2: 高压电机外形图

附件 3: 高压电机温度检测元件接线图

(三) 报名及采购文件获取方式:

(1) 报名及采购文件工本费缴纳时间: 自 2025 年 3 月 6 日 16 时 00 分 00 秒起到 2025 年 3 月 11 日 17 时 00 分 00 秒, 确认收到采购文件工本费的汇款后, 在报名截止日后 1 个工作日, 以电子邮件形式统一发售采购文件。

(2) 采购文件售价: 500 元/份, 售后不退 (报名单位从基本帐户汇款至宝鸡钛业股份有限公司并备注: 采购编号、名称的采购文件工本费)。

户 名: 宝鸡钛业股份有限公司 开户行: 中信银行宝鸡分行营业部

账 号: 7255010182100001639 行 号: 302793025505

(3) 报名信息 (以下信息以电子邮件发送, 发送后需电话确认):

A. 采购名称及采购编号、供应商名称、联系人及联系方式请标注在邮件正文;

B. 公司简介及业绩（电子版）以附件形式发送。（不接受超大附件）

C. 供应商银行基本账户信息及开票信息。

（4）报名联系人：刘女士 电话&传真：0917—3382130 电子邮箱：sbb@baoti.com

（5）技术洽谈联系人：娄小红 电话：13892734081

（四）未尽事宜联系宝鸡钛业股份有限公司资产设备部 刘女士

八、响应文件递交截止时间：2025 年 3 月 19 日 9 时 00 分 00 秒

递交方式：纸质文件递交

邮寄地址：陕西省宝鸡市渭滨区高新大道 88 号宝钛办公楼 15 楼资产设备部。

九、实施会时间及地点：

实施会时间：2025 年 3 月 19 日 9 时 00 分 00 秒

实施会地点：宝钛办公楼 15 楼会议室



采购项目负责人：娄小红（签字）

采购单位：宝鸡钛业股份有限公司资产设备部

**WEG Indústrias S.A.**

Nr.: 53104/2008

Date: 16-SEP-2008

DATA SHEET**Three-phase Induction Motor - Squirrel Cage**

Customer : Wepuko Hydraulik
Product code :
Product line : HGF NORMAL - CLASSE DE TENSÃO 5,1KV a 6,6KV

Frame : HGF 400C/D/E
Output : 450 kW
Frequency : 50 Hz
Poles : 6
Rated speed : 990 rpm
Slip : 1,00 %
Rated voltage : 6000V
Rated current : 53,9 A
L. R. Amperes : 334 A
I/In : 6,2
No load current : 20,0 A
Rated torque : 443 kgfm
Locked rotor torque : 120 %
Breakdown torque : 250 %
Insulation class : F
Temperature rise : 80 K
Locked rotor time : 20 s (hot)
Service factor : 1,00
Duty cycle : S1
Ambient temperature : 40°C
Altitude : 1000 m.a.s.l
Enclosure : IP55 (TEFC)
Mounting : B3R(E)
Rotation : Both
Aprox. weight* : 3615 kg
Moment of inertia : 22,708 kgm²
Sound Pressure Level : 82,0 dB(A)

	Front	Rear
Bearing	NU-224-C3	6320-C3
Regreasing int.	4500 h	4500 h
Grease amount	43 g	51 g
Grease - Polyrex EM - ESSO		

Load	Power factor	Efficiency (%)**
100%	0,84	95,6
75%	0,81	95,6
50%	0,72	95,1

Notes:

The figures given herewith are regarded as guaranteed values and applied to sinusoidal power supplied motors, within permissible tolerances under IEC 60034-1. Noise level with tolerance of +3 dB(A).

Performed
igorpauseChecked
jaimebRevision
Nr.: 0 Date: 16-SEP-2008

Approved







*Weight value can be changed without previous notification.

**Determining losses and efficiency according to IEC 34-2 A.

No reproduction of this drawing without written permission of WEG Motors	EXD	1	
	PROJAO	X	Dimensões em mm
	ESPECIAL		

Grounding for leads 50-70mm 2

THIS IS AN UPDATED REVISION. THE PREVIOUS ONE MUST BE DISCARDED.

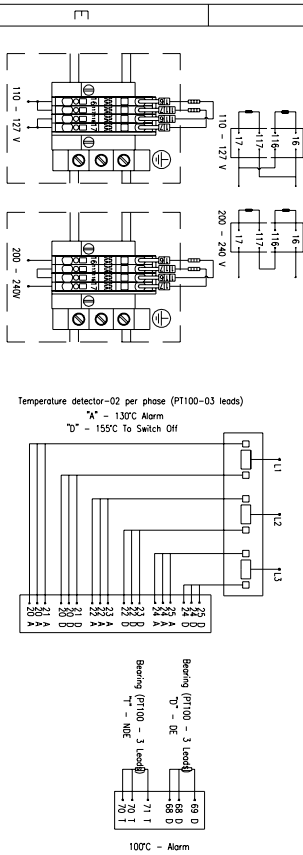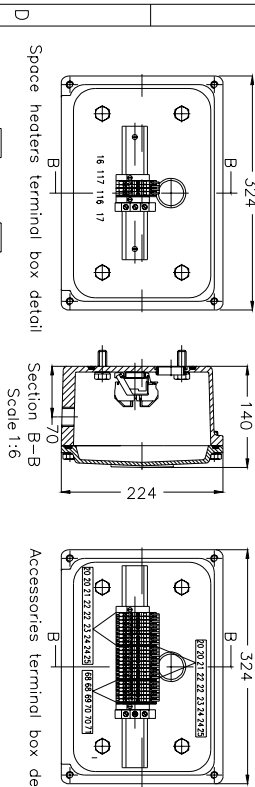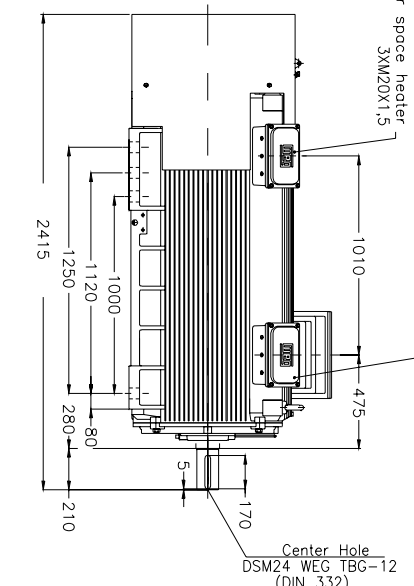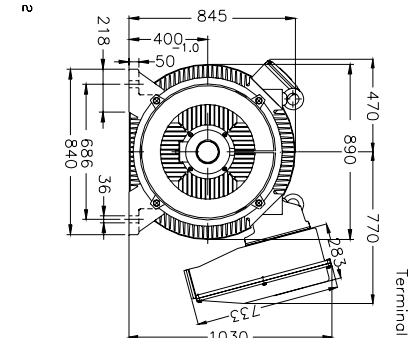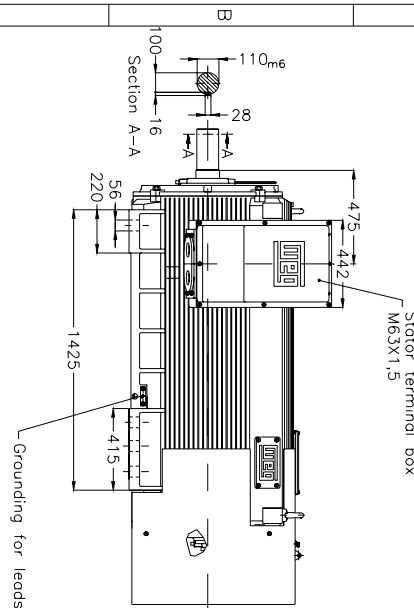


450 kW 06 Poles 50 Hz 6000 V

Plano de pintura 214P / Painting plan 214P		Forma construtiva B3E / Mounting B3(E)	
WEG GERMANY GMBH		THREE PHASE HOF MOTOR	
GROSS WEIGHT		NET WEIGHT	
DOCUMENTO NVO		DOCUMENTO NVO	
MODIF. NUMBER		SUMMARY OF MODIFICATIONS	
EXECUTED		EXECUTED	
RELEASED		RELEASED	
REL. DATE		Vends SHEET	
16.09.08		1 / 1	
10000274461		10000274461	
WEG		WEG	

Temperature detector—02 per phase (PT100—03 leads)

"A" — 130°C Alarm

"D" — 155°C To Switch Off

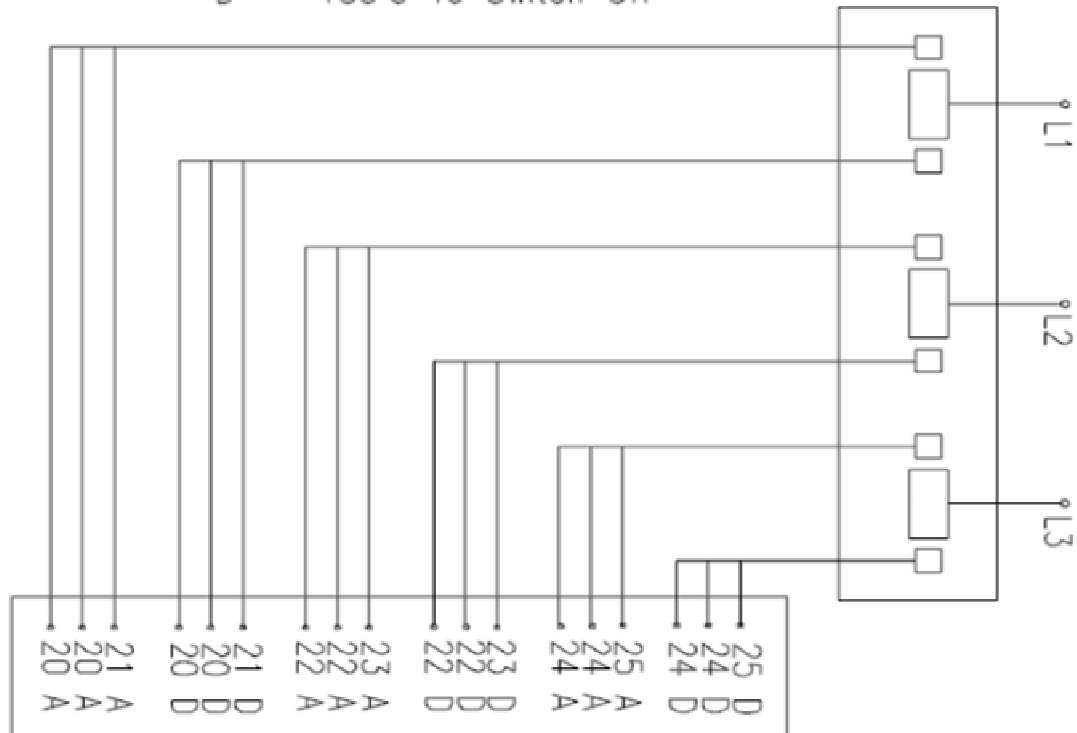


Bearing (PT100 — 3 Leads)

"D" — DE

Bearing (PT100 — 3 Leads)

"T" — NDE

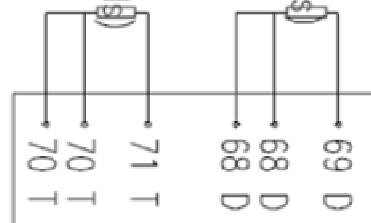

100°C — Alarm

120°C To Switch Off